


1. 事務所モデル (4123.50 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	790.5	40.2	435.5	14.8	23.3	368.2	1672.4
	47.3%	2.4%	26.0%	0.9%	1.4%	22.0%	100.0%
2地域	792.8	40.2	435.5	14.8	23.3	368.2	1674.7
	47.3%	2.4%	26.0%	0.9%	1.4%	22.0%	100.0%
3地域	742.1	40.2	435.5	14.1	23.3	368.2	1623.3
	45.7%	2.5%	26.8%	0.9%	1.4%	22.7%	100.0%
4地域	759.2	40.2	435.5	13.3	23.3	368.2	1639.7
	46.3%	2.4%	26.6%	0.8%	1.4%	22.5%	100.0%
5地域	808.3	40.2	435.5	12.6	23.3	368.2	1688.0
	47.9%	2.4%	25.8%	0.7%	1.4%	21.8%	100.0%
6地域	874.7	40.2	435.5	11.8	23.3	368.2	1753.7
	49.9%	2.3%	24.8%	0.7%	1.3%	21.0%	100.0%
7地域	879.9	40.2	435.5	10.4	23.3	368.2	1757.4
	50.1%	2.3%	24.8%	0.6%	1.3%	21.0%	100.0%
8地域	1102.2	40.2	435.5	8.9	23.3	368.2	1978.2
	55.7%	2.0%	22.0%	0.4%	1.2%	18.6%	100.0%


2地域

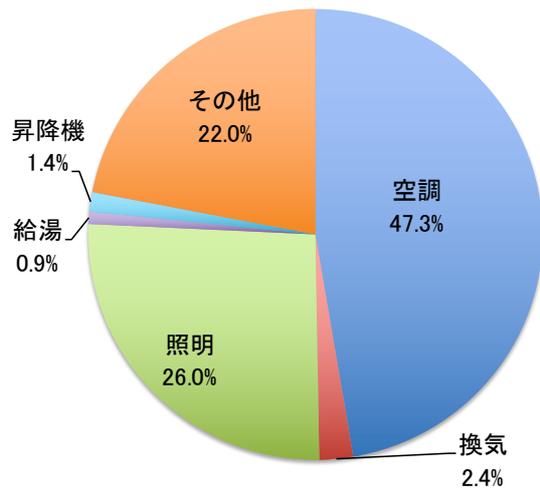


4地域

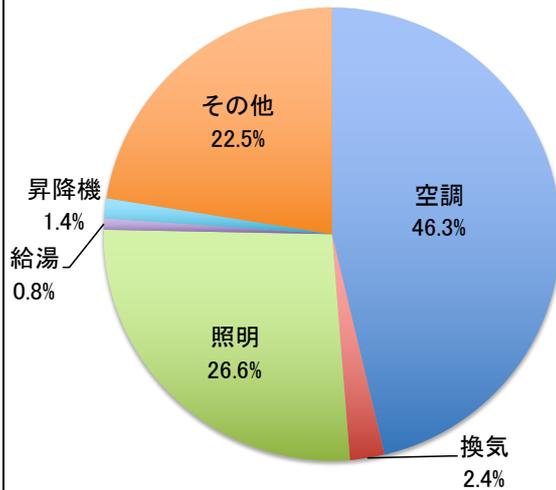

6地域

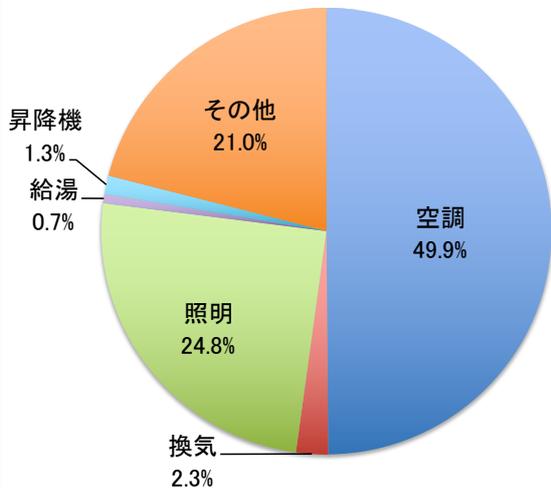

8地域

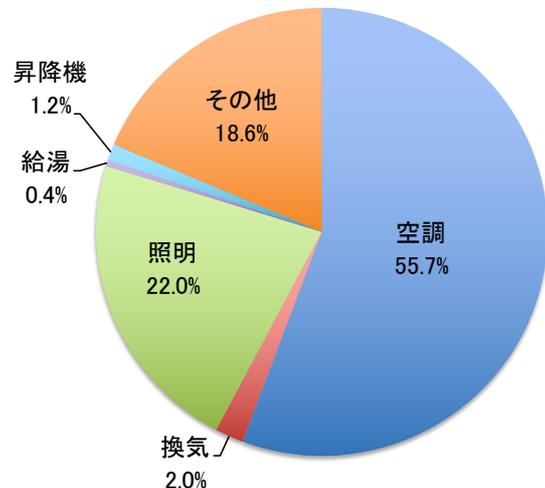


2. ビジネスホテルモデル (4751.05 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						計
	空調	換気	照明	給湯	昇降機	その他	
1地域	1769.3	74.5	478.9	5.7	36.1	108.3	2472.9
	71.5%	3.0%	19.4%	0.2%	1.5%	4.4%	100.0%
2地域	1664.0	74.5	478.9	5.5	36.1	108.3	2367.4
	70.3%	3.1%	20.2%	0.2%	1.5%	4.6%	100.0%
3地域	1507.2	74.5	478.9	5.2	36.1	108.3	2210.3
	68.2%	3.4%	21.7%	0.2%	1.6%	4.9%	100.0%
4地域	1516.1	74.5	478.9	5.1	36.1	108.3	2219.1
	68.3%	3.4%	21.6%	0.2%	1.6%	4.9%	100.0%
5地域	1625.6	74.5	478.9	4.8	36.1	108.3	2328.3
	69.8%	3.2%	20.6%	0.2%	1.6%	4.7%	100.0%
6地域	1668.5	74.5	478.9	4.4	36.1	108.3	2370.8
	70.4%	3.1%	20.2%	0.2%	1.5%	4.6%	100.0%
7地域	1688.2	74.5	478.9	4.0	36.1	108.3	2390.1
	70.6%	3.1%	20.0%	0.2%	1.5%	4.5%	100.0%
8地域	2004.7	74.5	478.9	3.3	36.1	108.3	2705.9
	74.1%	2.8%	17.7%	0.1%	1.3%	4.0%	100.0%


2地域

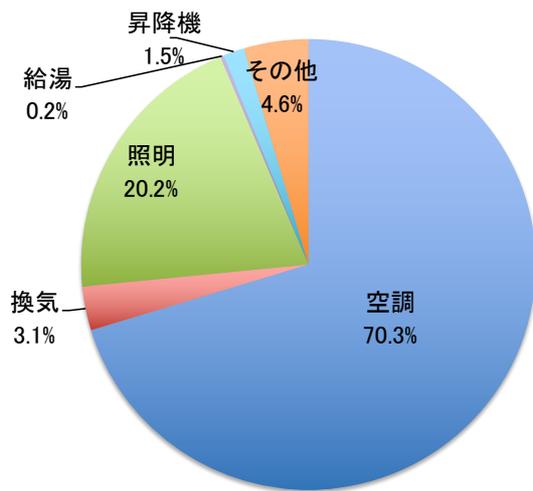


4地域

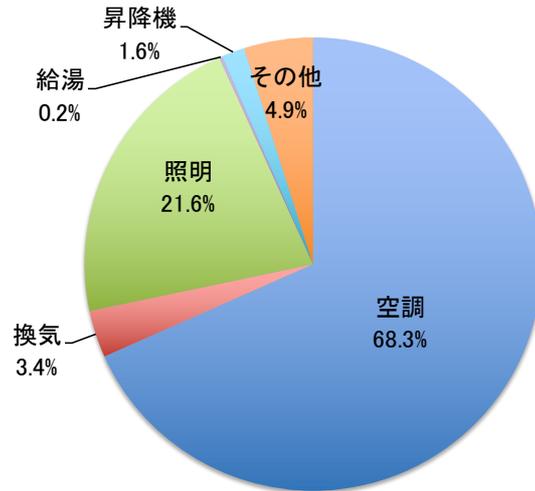

6地域

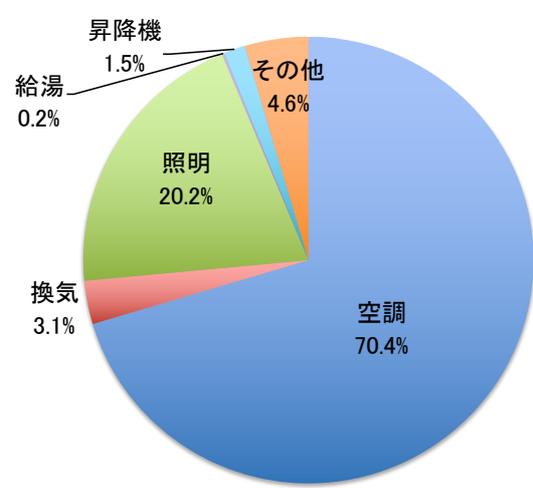





8地域

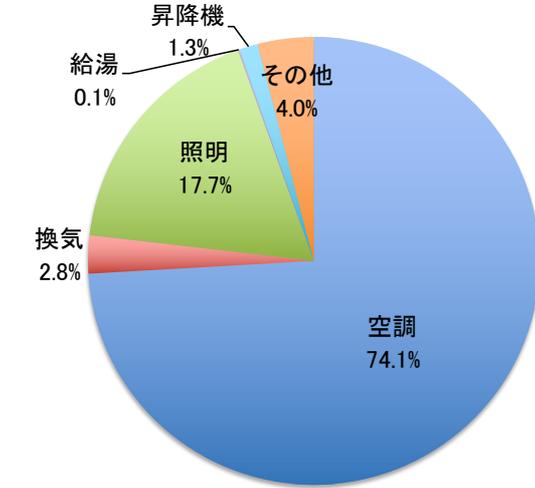

3. シティホテルモデル (15412.50 m²)

※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	1855.0	107.0	541.9	20.4	14.5	69.5	2608.2
	71.1%	4.1%	20.8%	0.8%	0.6%	2.7%	100.0%
2地域	1795.6	107.0	541.9	19.9	14.5	69.5	2548.4
	70.5%	4.2%	21.3%	0.8%	0.6%	2.7%	100.0%
3地域	1832.6	107.0	541.9	18.7	14.5	69.5	2584.2
	70.9%	4.1%	21.0%	0.7%	0.6%	2.7%	100.0%
4地域	1875.2	107.0	541.9	18.2	14.5	69.5	2626.3
	71.4%	4.1%	20.6%	0.7%	0.6%	2.6%	100.0%
5地域	2051.5	107.0	541.9	17.2	14.5	69.5	2801.7
	73.2%	3.8%	19.3%	0.6%	0.5%	2.5%	100.0%
6地域	2120.6	107.0	541.9	15.7	14.5	69.5	2869.2
	73.9%	3.7%	18.9%	0.5%	0.5%	2.4%	100.0%
7地域	2194.5	107.0	541.9	14.3	14.5	69.5	2941.7
	74.6%	3.6%	18.4%	0.5%	0.5%	2.4%	100.0%
8地域	2670.9	107.0	541.9	11.6	14.5	69.5	3415.4
	78.2%	3.1%	15.9%	0.3%	0.4%	2.0%	100.0%

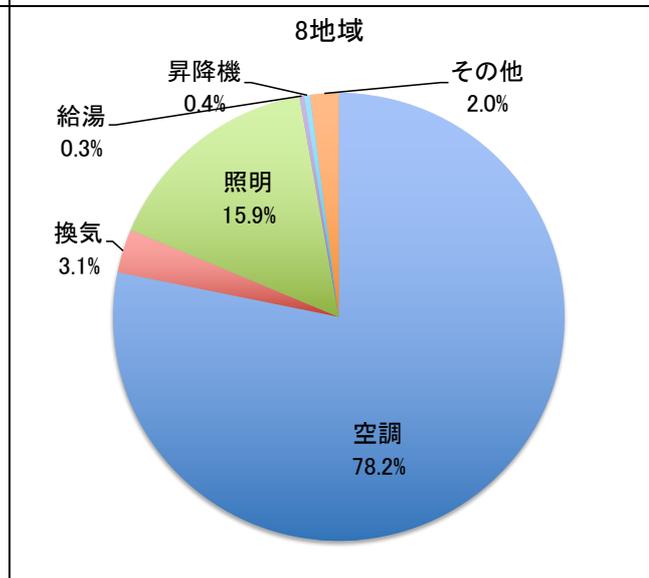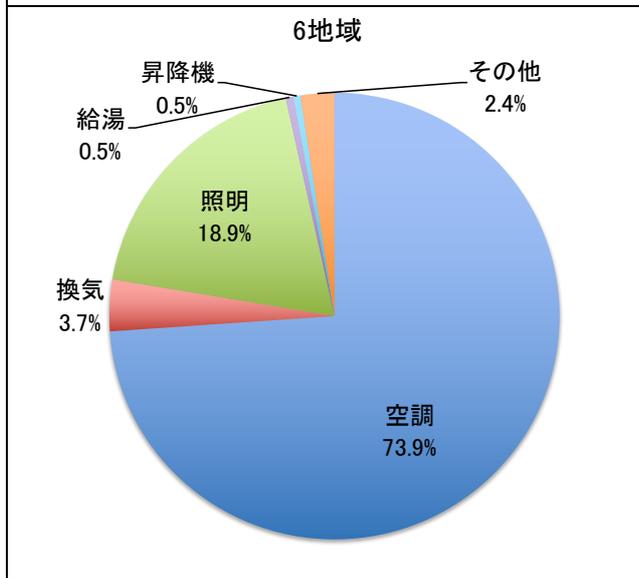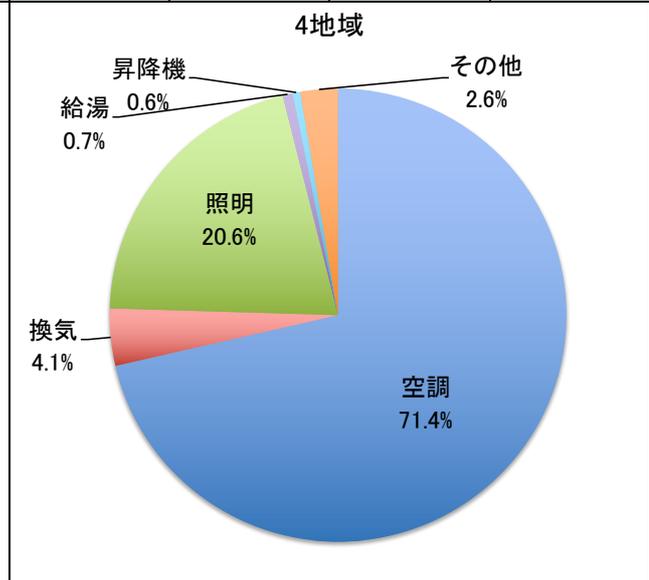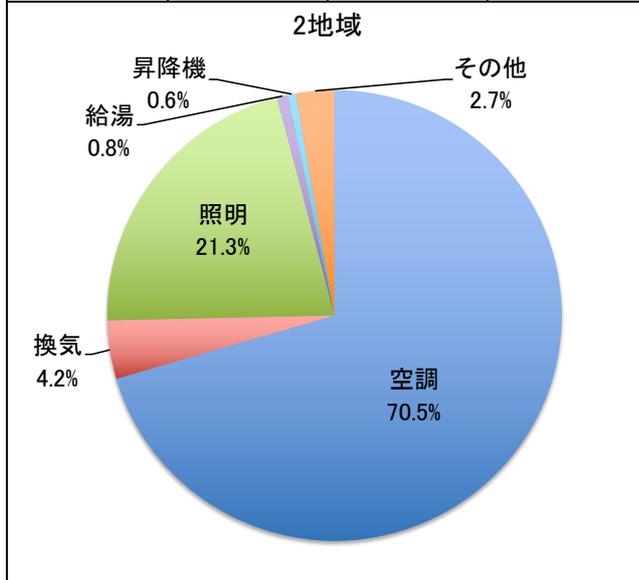


4. 総合病院モデル (4555.71 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	1048.2	120.7	457.6	2.2	39.0	152.6	1820.2
	57.6%	6.6%	25.1%	0.1%	2.1%	8.4%	100.0%
2地域	989.1	120.7	457.6	2.1	39.0	152.6	1761.1
	56.2%	6.9%	26.0%	0.1%	2.2%	8.7%	100.0%
3地域	802.7	120.7	457.6	2.0	39.0	152.6	1574.6
	51.0%	7.7%	29.1%	0.1%	2.5%	9.7%	100.0%
4地域	805.0	120.7	457.6	2.0	39.0	152.6	1576.8
	51.1%	7.7%	29.0%	0.1%	2.5%	9.7%	100.0%
5地域	817.1	120.7	457.6	1.9	39.0	152.6	1588.8
	51.4%	7.6%	28.8%	0.1%	2.5%	9.6%	100.0%
6地域	841.3	120.7	457.6	1.7	39.0	152.6	1612.8
	52.2%	7.5%	28.4%	0.1%	2.4%	9.5%	100.0%
7地域	826.9	120.7	457.6	1.6	39.0	152.6	1598.3
	51.7%	7.6%	28.6%	0.1%	2.4%	9.5%	100.0%
8地域	957.3	120.7	457.6	1.2	39.0	152.6	1728.4
	55.4%	7.0%	26.5%	0.1%	2.3%	8.8%	100.0%


2地域

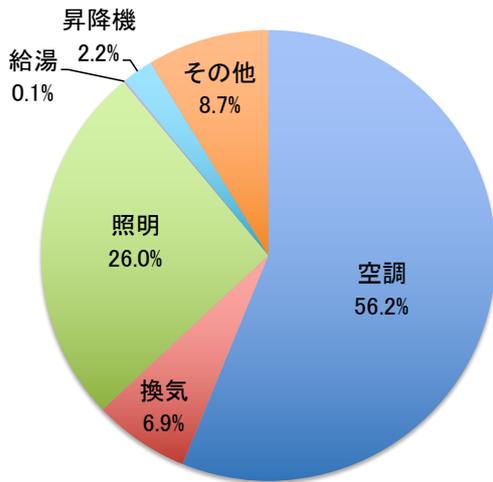


4地域

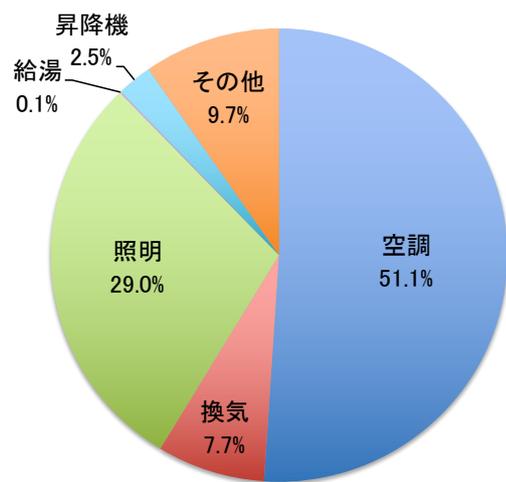

6地域

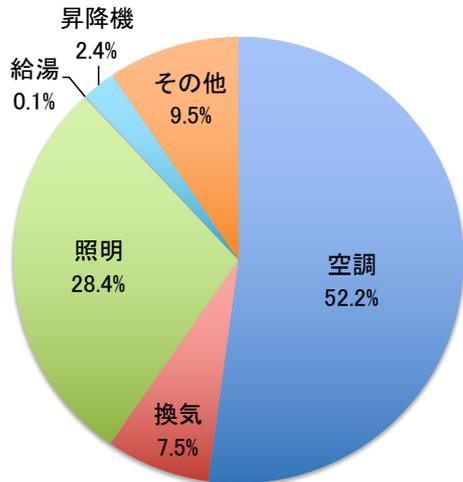

8地域

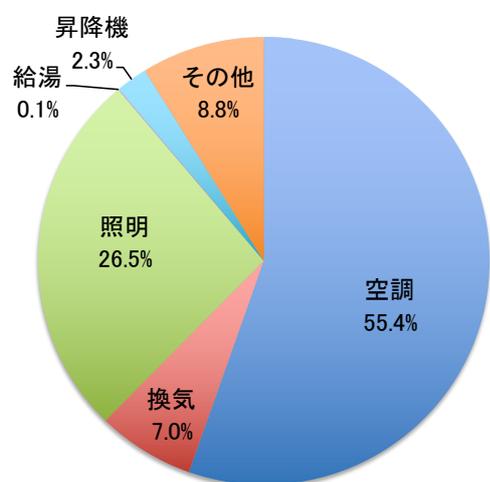


5. クリニックモデル (429.80 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	696.3	85.7	329.4	29.4	100.5	205.7	1446.9
	48.1%	5.9%	22.8%	2.0%	6.9%	14.2%	100.0%
2地域	683.8	85.7	329.4	28.8	100.5	205.7	1433.8
	47.7%	6.0%	23.0%	2.0%	7.0%	14.3%	100.0%
3地域	584.4	85.7	329.4	26.9	100.5	205.7	1332.5
	43.9%	6.4%	24.7%	2.0%	7.5%	15.4%	100.0%
4地域	600.8	85.7	329.4	26.2	100.5	205.7	1348.3
	44.6%	6.4%	24.4%	1.9%	7.5%	15.3%	100.0%
5地域	609.7	85.7	329.4	25.0	100.5	205.7	1355.9
	45.0%	6.3%	24.3%	1.8%	7.4%	15.2%	100.0%
6地域	653.5	85.7	329.4	22.7	100.5	205.7	1397.4
	46.8%	6.1%	23.6%	1.6%	7.2%	14.7%	100.0%
7地域	650.8	85.7	329.4	20.8	100.5	205.7	1392.8
	46.7%	6.2%	23.6%	1.5%	7.2%	14.8%	100.0%
8地域	786.8	85.7	329.4	16.8	100.5	205.7	1524.8
	51.6%	5.6%	21.6%	1.1%	6.6%	13.5%	100.0%


2地域

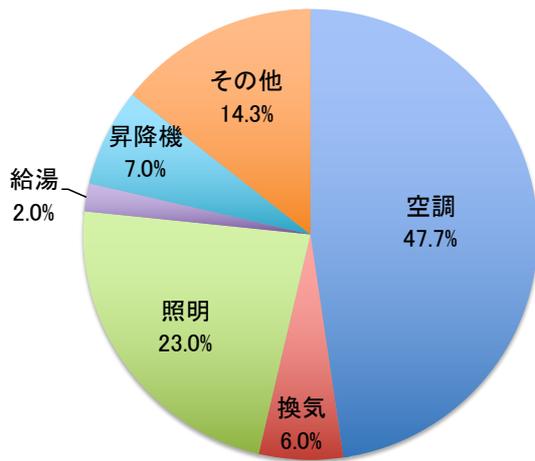


4地域

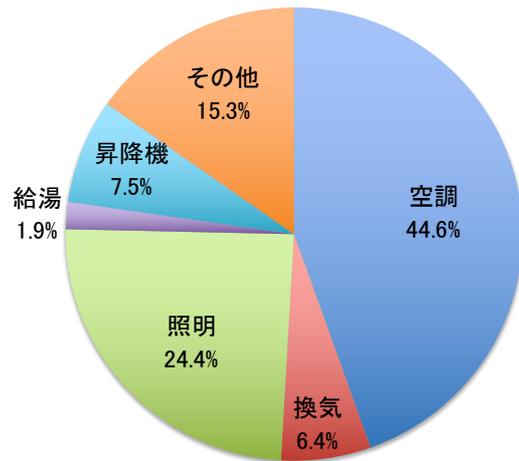

6地域

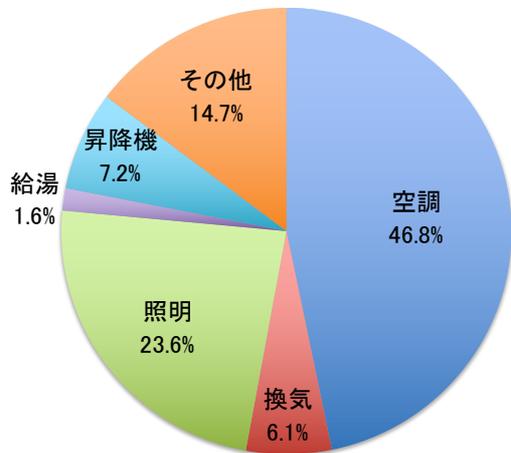

8地域

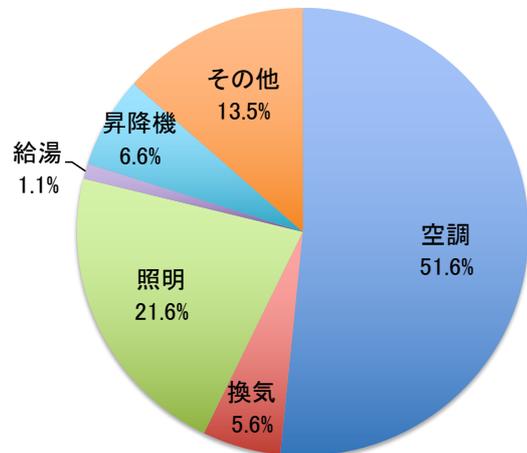


6. 福祉施設モデル (6040.86 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	1644.8	100.1	460.3	3.8	13.3	118.1	2340.4
	70.3%	4.3%	19.7%	0.2%	0.6%	5.0%	100.0%
2地域	1547.6	100.1	460.3	3.8	13.3	118.1	2243.3
	69.0%	4.5%	20.5%	0.2%	0.6%	5.3%	100.0%
3地域	1267.7	100.1	460.3	3.5	13.3	118.1	1963.1
	64.6%	5.1%	23.4%	0.2%	0.7%	6.0%	100.0%
4地域	1271.1	100.1	460.3	3.4	13.3	118.1	1966.4
	64.6%	5.1%	23.4%	0.2%	0.7%	6.0%	100.0%
5地域	1290.1	100.1	460.3	3.3	13.3	118.1	1985.2
	65.0%	5.0%	23.2%	0.2%	0.7%	5.9%	100.0%
6地域	1324.6	100.1	460.3	3.0	13.3	118.1	2019.4
	65.6%	5.0%	22.8%	0.1%	0.7%	5.8%	100.0%
7地域	1318.1	100.1	460.3	2.7	13.3	118.1	2012.7
	65.5%	5.0%	22.9%	0.1%	0.7%	5.9%	100.0%
8地域	1514.8	100.1	460.3	2.2	13.3	118.1	2208.9
	68.6%	4.5%	20.8%	0.1%	0.6%	5.3%	100.0%


2地域

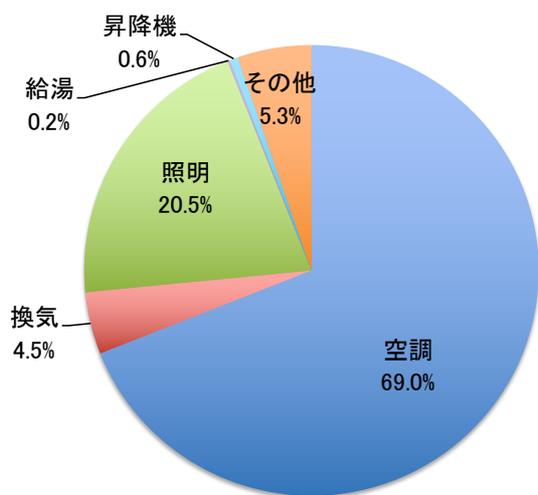


4地域

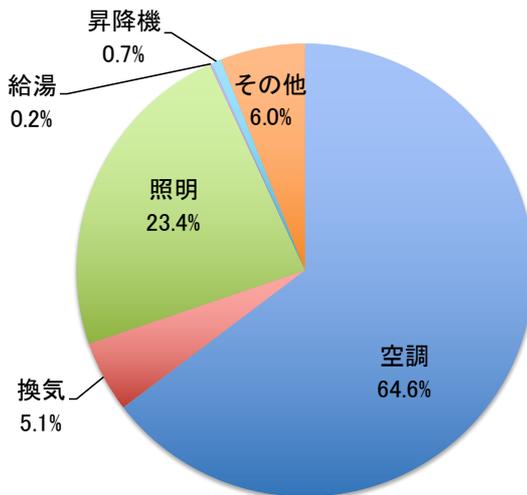

6地域

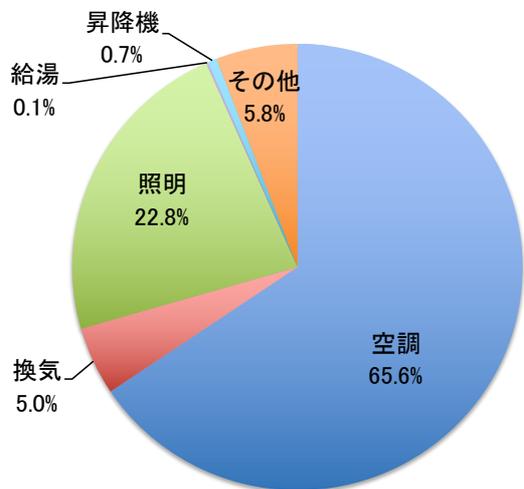

8地域

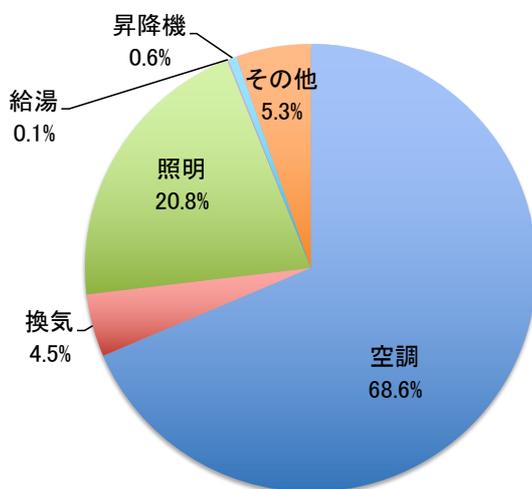


7. 大規模物販モデル (4394.62 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	1867.6	84.9	638.8	45.4	41.6	1250.5	3928.8
	47.5%	2.2%	16.3%	1.2%	1.1%	31.8%	100.0%
2地域	1788.1	84.9	638.8	43.9	41.6	1250.5	3847.8
	46.5%	2.2%	16.6%	1.1%	1.1%	32.5%	100.0%
3地域	1496.8	84.9	638.8	41.7	41.6	1250.5	3554.3
	42.1%	2.4%	18.0%	1.2%	1.2%	35.2%	100.0%
4地域	1522.6	84.9	638.8	40.3	41.6	1250.5	3578.7
	42.5%	2.4%	17.9%	1.1%	1.2%	34.9%	100.0%
5地域	1528.5	84.9	638.8	38.1	41.6	1250.5	3582.3
	42.7%	2.4%	17.8%	1.1%	1.2%	34.9%	100.0%
6地域	1586.6	84.9	638.8	35.1	41.6	1250.5	3637.6
	43.6%	2.3%	17.6%	1.0%	1.1%	34.4%	100.0%
7地域	1579.9	84.9	638.8	31.5	41.6	1250.5	3627.2
	43.6%	2.3%	17.6%	0.9%	1.1%	34.5%	100.0%
8地域	1834.3	84.9	638.8	25.6	41.6	1250.5	3875.8
	47.3%	2.2%	16.5%	0.7%	1.1%	32.3%	100.0%


2地域

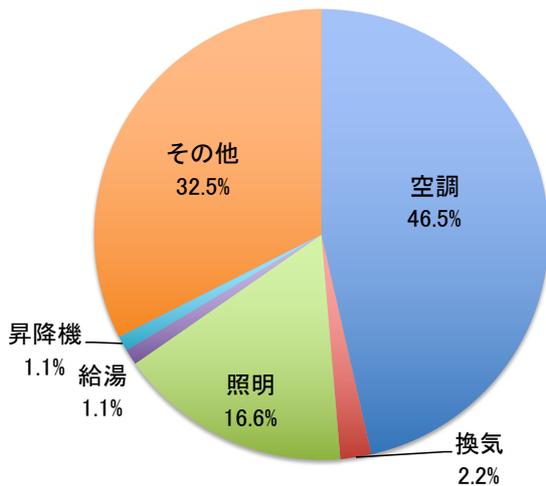


4地域

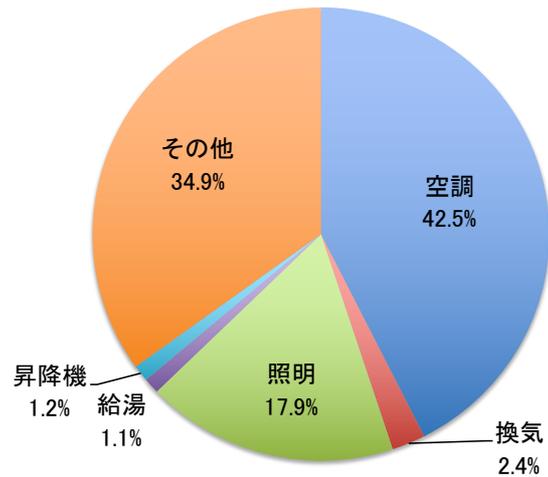

6地域

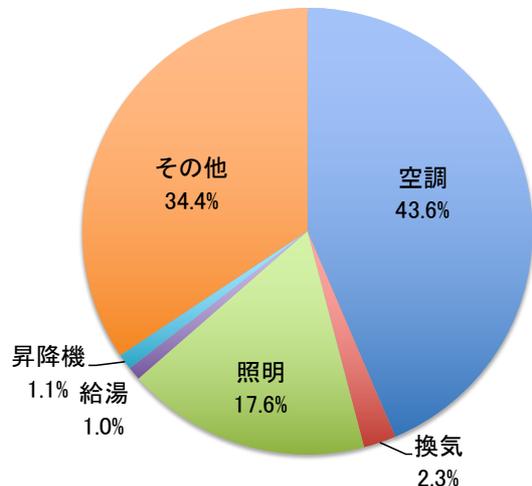

8地域

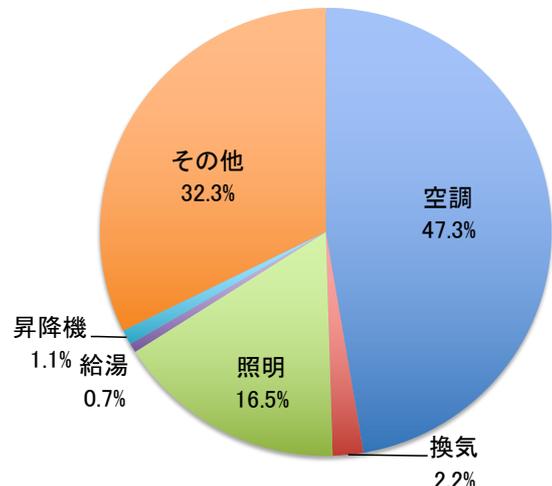


8. 小規模物販モデル (386.00 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	2206.1 46.3%	91.8 1.9%	726.7 15.3%	53.3 1.1%	188.3 4.0%	1495.9 31.4%	4762.1 100.0%
2地域	2113.3 45.3%	91.8 2.0%	726.7 15.6%	51.5 1.1%	188.3 4.0%	1495.9 32.0%	4667.6 100.0%
3地域	1775.0 41.0%	91.8 2.1%	726.7 16.8%	49.0 1.1%	188.3 4.4%	1495.9 34.6%	4326.7 100.0%
4地域	1806.4 41.5%	91.8 2.1%	726.7 16.7%	47.2 1.1%	188.3 4.3%	1495.9 34.3%	4356.4 100.0%
5地域	1815.1 41.6%	91.8 2.1%	726.7 16.7%	44.7 1.0%	188.3 4.3%	1495.9 34.3%	4362.5 100.0%
6地域	1883.9 42.5%	91.8 2.1%	726.7 16.4%	41.2 0.9%	188.3 4.3%	1495.9 33.8%	4427.8 100.0%
7地域	1877.0 42.5%	91.8 2.1%	726.7 16.5%	36.9 0.8%	188.3 4.3%	1495.9 33.9%	4416.7 100.0%
8地域	2181.5 46.3%	91.8 1.9%	726.7 15.4%	30.1 0.6%	188.3 4.0%	1495.9 31.7%	4714.3 100.0%


2地域

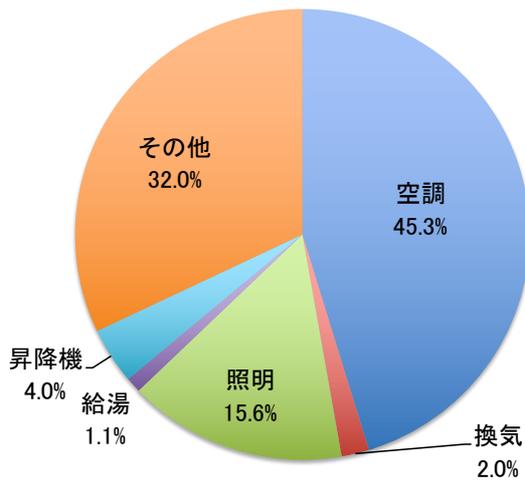


4地域

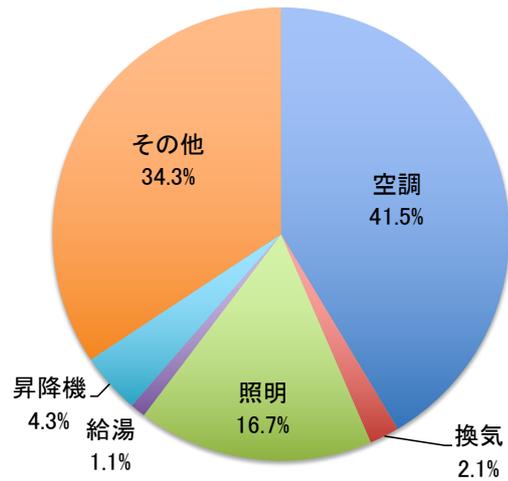

6地域

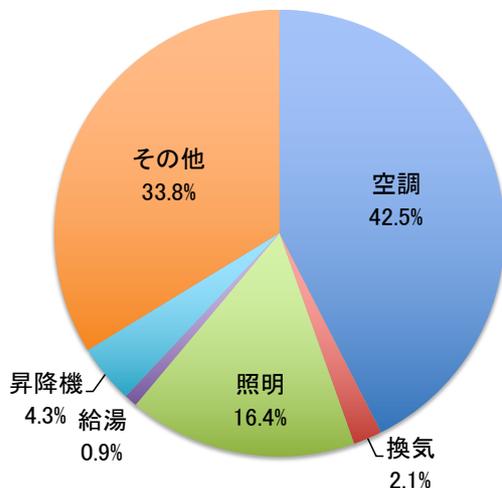

8地域

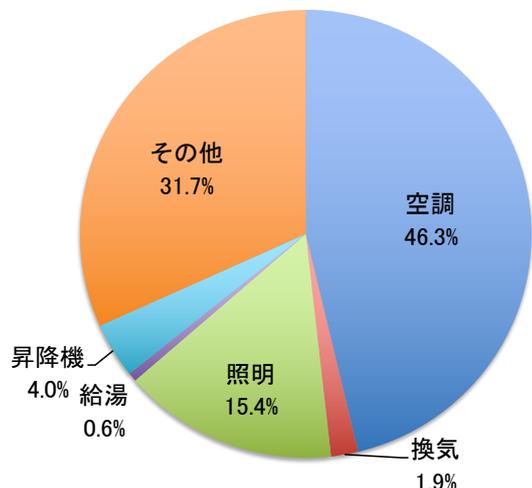


9. 学校モデル (4945.43 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	353.7	66.5	187.9	5.9	2.2	21.7	637.8
	55.5%	10.4%	29.5%	0.9%	0.4%	3.4%	100.0%
2地域	348.6	66.5	187.9	5.7	2.2	21.7	632.6
	55.1%	10.5%	29.7%	0.9%	0.4%	3.4%	100.0%
3地域	274.8	66.5	187.9	5.4	2.2	21.7	558.4
	49.2%	11.9%	33.6%	1.0%	0.4%	3.9%	100.0%
4地域	272.8	66.5	187.9	5.2	2.2	21.7	556.3
	49.0%	11.9%	33.8%	0.9%	0.4%	3.9%	100.0%
5地域	332.5	66.5	187.9	4.9	2.2	21.7	615.7
	54.0%	10.8%	30.5%	0.8%	0.4%	3.5%	100.0%
6地域	362.1	66.5	187.9	4.5	2.2	21.7	644.9
	56.2%	10.3%	29.1%	0.7%	0.3%	3.4%	100.0%
7地域	350.5	66.5	187.9	4.2	2.2	21.7	632.9
	55.4%	10.5%	29.7%	0.7%	0.4%	3.4%	100.0%
8地域	445.2	66.5	187.9	3.4	2.2	21.7	726.8
	61.3%	9.1%	25.8%	0.5%	0.3%	3.0%	100.0%


2地域

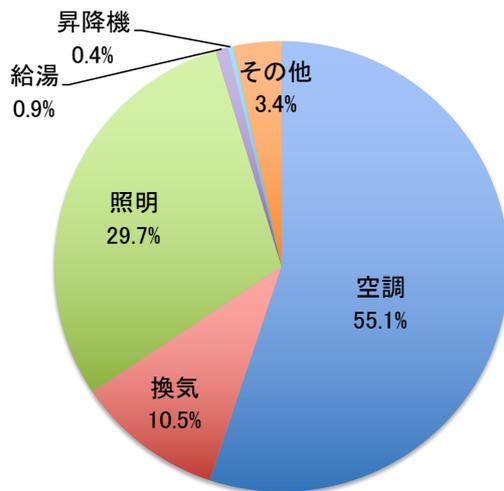


4地域

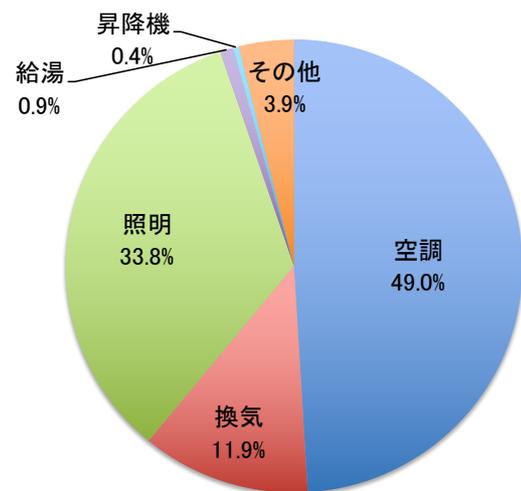

6地域

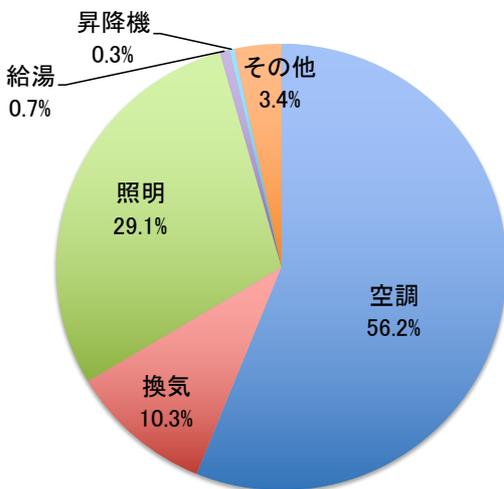





8地域

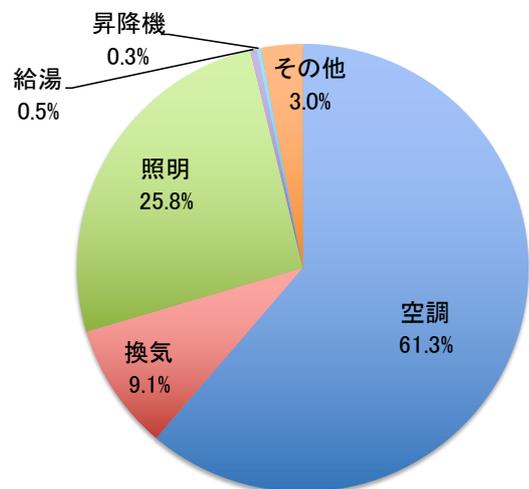

10. 幼稚園モデル (2405.96 m²)

※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	306.0	54.8	212.0	4.1	20.0	25.9	622.8
	49.1%	8.8%	34.0%	0.7%	3.2%	4.2%	100.0%
2地域	305.7	54.8	212.0	4.0	20.0	25.9	622.3
	49.1%	8.8%	34.1%	0.6%	3.2%	4.2%	100.0%
3地域	253.4	54.8	212.0	3.7	20.0	25.9	569.7
	44.5%	9.6%	37.2%	0.7%	3.5%	4.5%	100.0%
4地域	251.2	54.8	212.0	3.6	20.0	25.9	567.4
	44.3%	9.6%	37.4%	0.6%	3.5%	4.6%	100.0%
5地域	305.9	54.8	212.0	3.5	20.0	25.9	622.0
	49.2%	8.8%	34.1%	0.6%	3.2%	4.2%	100.0%
6地域	334.0	54.8	212.0	3.1	20.0	25.9	649.7
	51.4%	8.4%	32.6%	0.5%	3.1%	4.0%	100.0%
7地域	321.8	54.8	212.0	2.9	20.0	25.9	637.3
	50.5%	8.6%	33.3%	0.5%	3.1%	4.1%	100.0%
8地域	419.9	54.8	212.0	2.3	20.0	25.9	734.8
	57.1%	7.5%	28.8%	0.3%	2.7%	3.5%	100.0%

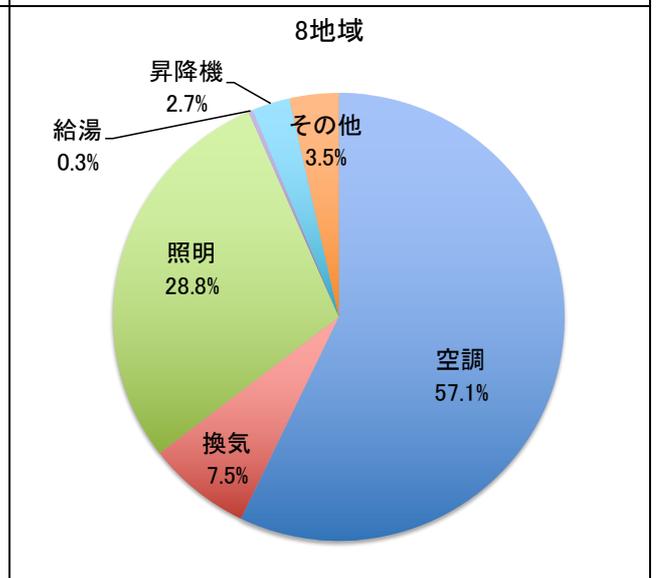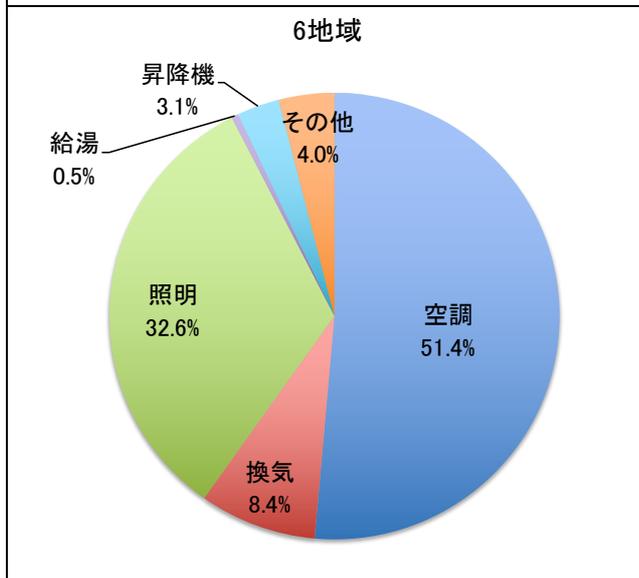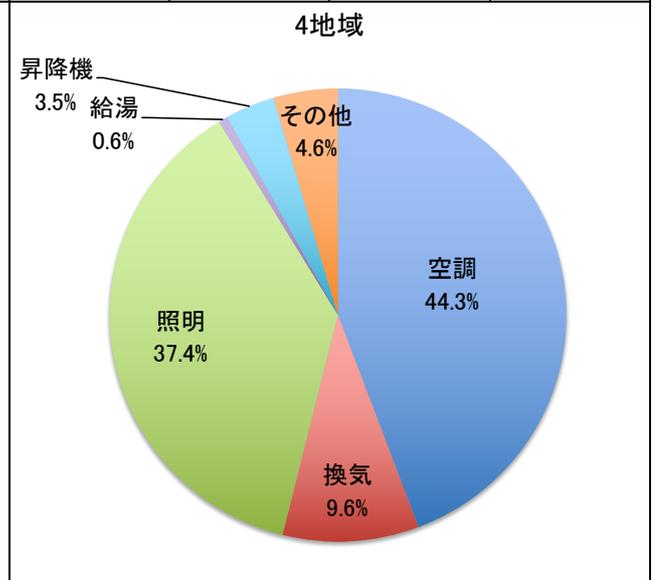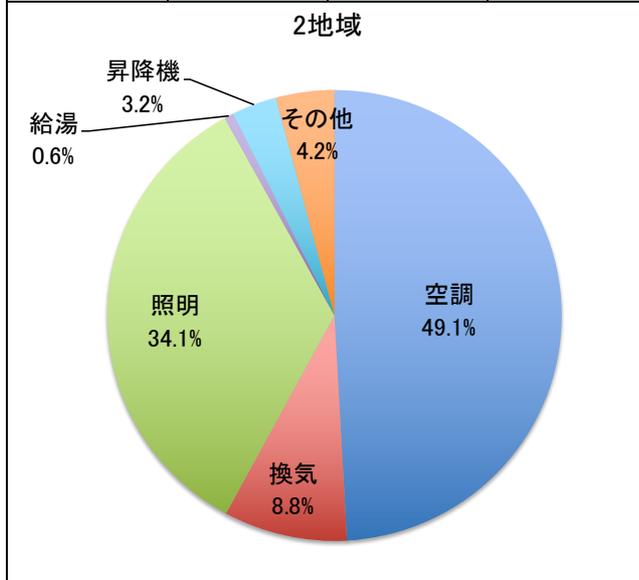


11. 大学モデル (9250.30 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	544.9	68.6	285.2	28.1	35.2	197.7	1159.7
	47.0%	5.9%	24.6%	2.4%	3.0%	17.0%	100.0%
2地域	538.6	68.6	285.2	27.4	35.2	197.7	1152.6
	46.7%	6.0%	24.7%	2.4%	3.1%	17.1%	100.0%
3地域	489.3	68.6	285.2	25.6	35.2	197.7	1101.5
	44.4%	6.2%	25.9%	2.3%	3.2%	17.9%	100.0%
4地域	500.0	68.6	285.2	24.9	35.2	197.7	1111.5
	45.0%	6.2%	25.7%	2.2%	3.2%	17.8%	100.0%
5地域	532.2	68.6	285.2	23.9	35.2	197.7	1142.8
	46.6%	6.0%	25.0%	2.1%	3.1%	17.3%	100.0%
6地域	567.3	68.6	285.2	21.5	35.2	197.7	1175.5
	48.3%	5.8%	24.3%	1.8%	3.0%	16.8%	100.0%
7地域	563.7	68.6	285.2	19.9	35.2	197.7	1170.3
	48.2%	5.9%	24.4%	1.7%	3.0%	16.9%	100.0%
8地域	725.5	68.6	285.2	15.9	35.2	197.7	1328.0
	54.6%	5.2%	21.5%	1.2%	2.6%	14.9%	100.0%


2地域

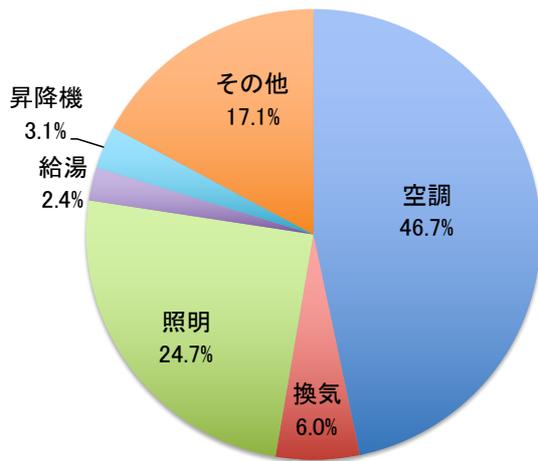


4地域

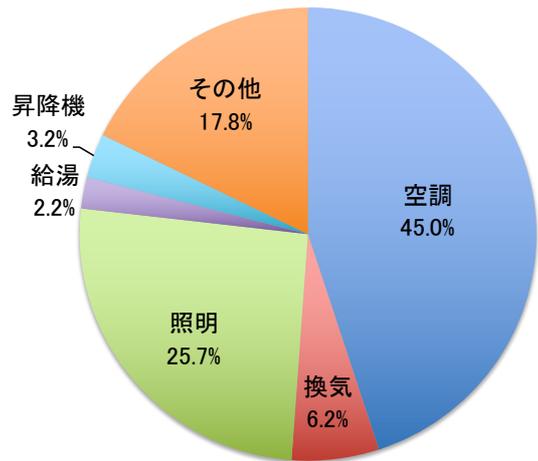

6地域

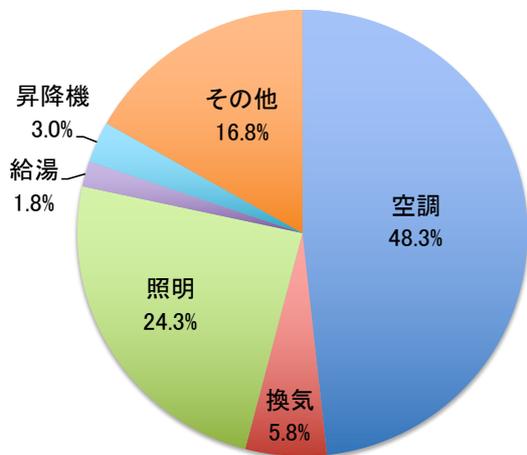





8地域

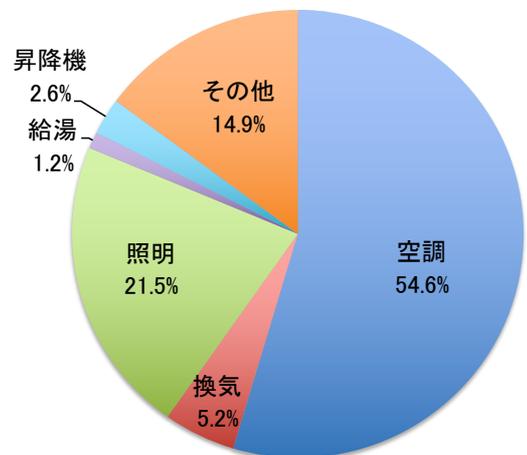

12. 講堂モデル (4600.87 m²)

※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	474.2	77.6	154.0	55.5	1.3	0.0	762.6
	62.2%	10.2%	20.2%	7.3%	0.2%	0.0%	100.0%
2地域	472.0	77.6	154.0	54.7	1.3	0.0	759.7
	62.1%	10.2%	20.3%	7.2%	0.2%	0.0%	100.0%
3地域	398.8	77.6	154.0	51.2	1.3	0.0	682.9
	58.4%	11.4%	22.6%	7.5%	0.2%	0.0%	100.0%
4地域	411.1	77.6	154.0	49.6	1.3	0.0	693.6
	59.3%	11.2%	22.2%	7.2%	0.2%	0.0%	100.0%
5地域	426.9	77.6	154.0	47.3	1.3	0.0	707.1
	60.4%	11.0%	21.8%	6.7%	0.2%	0.0%	100.0%
6地域	461.5	77.6	154.0	43.0	1.3	0.0	737.4
	62.6%	10.5%	20.9%	5.8%	0.2%	0.0%	100.0%
7地域	451.0	77.6	154.0	39.1	1.3	0.0	723.0
	62.4%	10.7%	21.3%	5.4%	0.2%	0.0%	100.0%
8地域	567.2	77.6	154.0	31.6	1.3	0.0	831.8
	68.2%	9.3%	18.5%	3.8%	0.2%	0.0%	100.0%

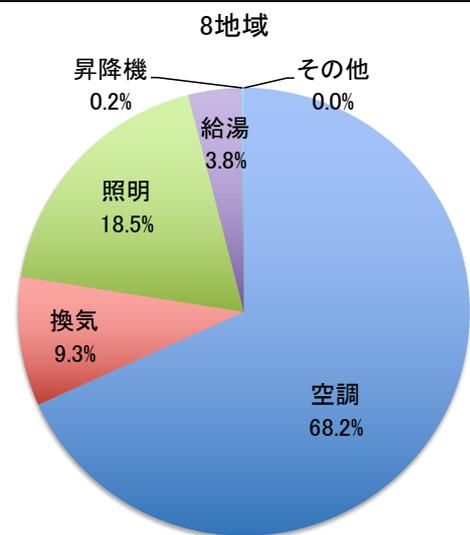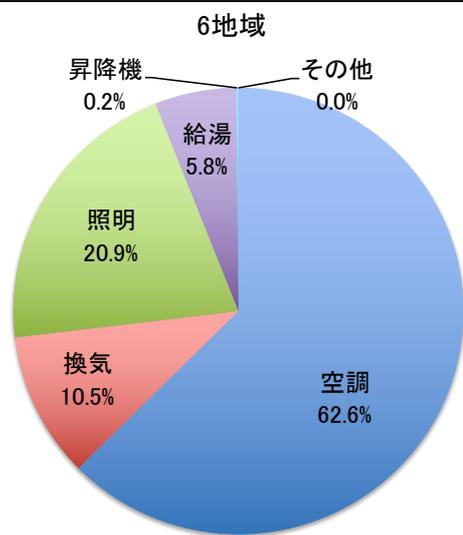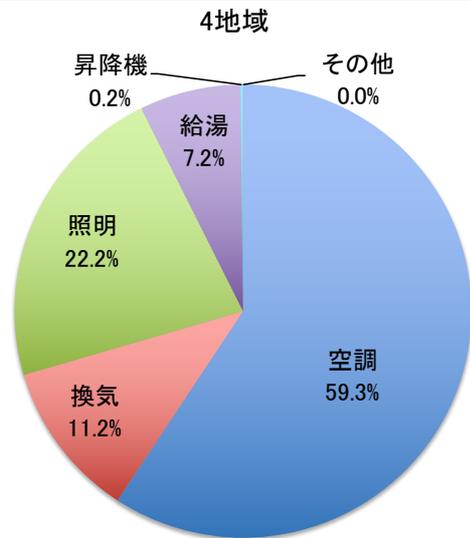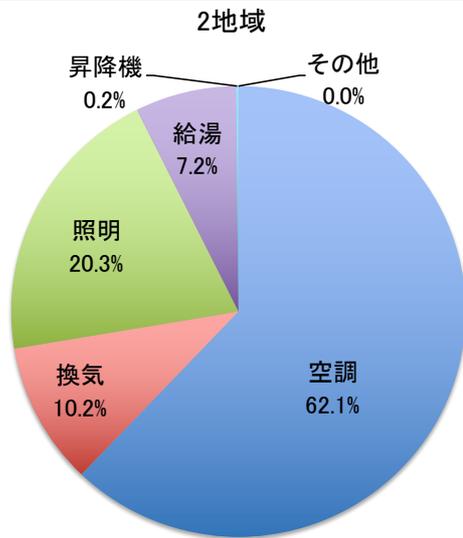


13. 飲食店モデル (1534.40 m²)


※ 表中の基準値には駐車場及び厨房に設置された換気設備、厨房のための給湯設備のエネルギー消費量は含まれていません。

地域	基準一次エネルギー消費量 [MJ/(m ² ・年)]						
	空調	換気	照明	給湯	昇降機	その他	計
1地域	1331.0	49.3	780.8	0.7	17.8	712.0	2891.6
	46.0%	1.7%	27.0%	0.0%	0.6%	24.6%	100.0%
2地域	1324.9	49.3	780.8	0.7	17.8	712.0	2885.5
	45.9%	1.7%	27.1%	0.0%	0.6%	24.7%	100.0%
3地域	1256.8	49.3	780.8	0.6	17.8	712.0	2817.3
	44.6%	1.8%	27.7%	0.0%	0.6%	25.3%	100.0%
4地域	1311.5	49.3	780.8	0.6	17.8	712.0	2872.1
	45.7%	1.7%	27.2%	0.0%	0.6%	24.8%	100.0%
5地域	1383.9	49.3	780.8	0.6	17.8	712.0	2944.4
	47.0%	1.7%	26.5%	0.0%	0.6%	24.2%	100.0%
6地域	1418.4	49.3	780.8	0.6	17.8	712.0	2978.8
	47.6%	1.7%	26.2%	0.0%	0.6%	23.9%	100.0%
7地域	1395.3	49.3	780.8	0.5	17.8	712.0	2955.7
	47.2%	1.7%	26.4%	0.0%	0.6%	24.1%	100.0%
8地域	1694.3	49.3	780.8	0.4	17.8	712.0	3254.6
	52.1%	1.5%	24.0%	0.0%	0.5%	21.9%	100.0%


2地域

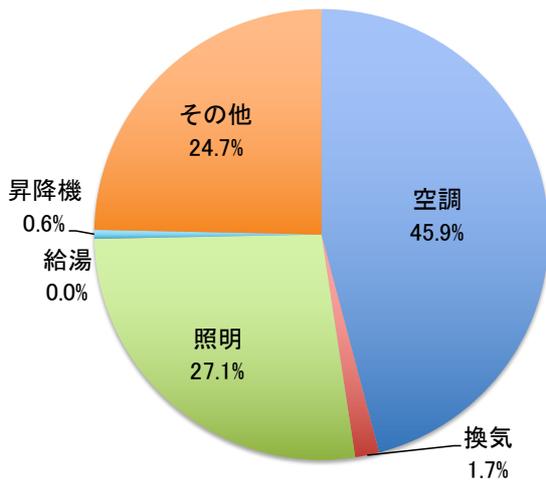

4地域

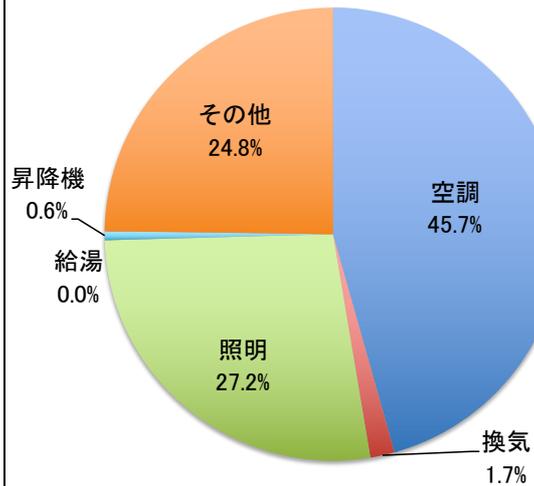

6地域

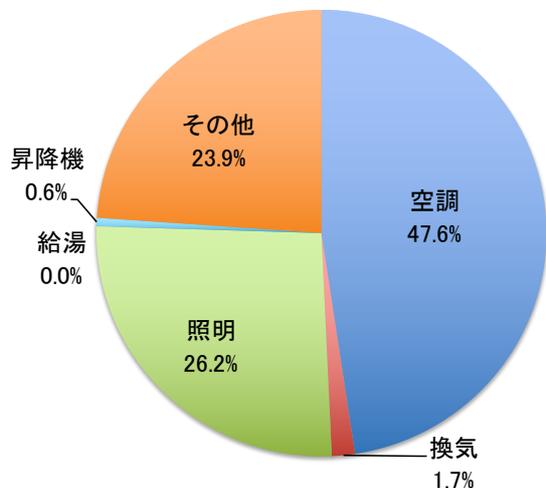

8地域

